## SUPREME - chlorhexidine gluconate liquid BouMatic, LLC

Disclaimer: This drug has not been found by FDA to be safe and effective, and this labeling has not been approved by FDA. For further information about unapproved drugs, click here.

-----

### Supreme

Helps reduce the spread of organisms which may cause Mastitis

USE DIRECTIONS

NOT FOR HUMAN USE

FOR EXTERNAL USE ONLY

USE AT FULL STRENGTH

PRE-DIPPING: Before milking, dip entire teat with this product. Wipe teats dry after application using singleservice towels to avoid contamination of milk.

POST-DIPPING: After milking, dip entire teat with this product. Allow to air dry.

Note: If solution in cup becomes visibly dirty, replenish with a fresh mixture of this product. Do not return unused product to original container.

CAUTION

# KEEP OUT OF REACH OF CHILDREN

NOT FOR HUMAN USE

FIRST AID:

If in eyes: Hold eye open and rinse slowly and gently with water for 15-20 minutes. Remove contact lenses,

if present after the first 5 minutes, then continue rinsing. Contact a physician immediately. If swallowed: Have person sip a glass of water if able to swallow. Do not give anything to an unconscious person. Do not

induce vomiting. Contact a physician immediately. If breathing difficulty occurs: Move person to fresh air.

Contact a physician immediately. If on skin: Take off contaminated clothing. Rinse skin with soap and water.

If irritation develops and persists, contact a physician.


Have the product container or label with you when going for treatment, calling a physician, the emergency

number listed on this label or MSDS, or a poison control center.

PRECAUTION: Avoid eye contact. Do not ingest. Do not mix with any chemicals except as directed.

STORAGE: Store in a closed container away from sources of heat. If product becomes frozen, thaw and mix well before use.

### SEE MATERIAL SAFETY DATA SHEET

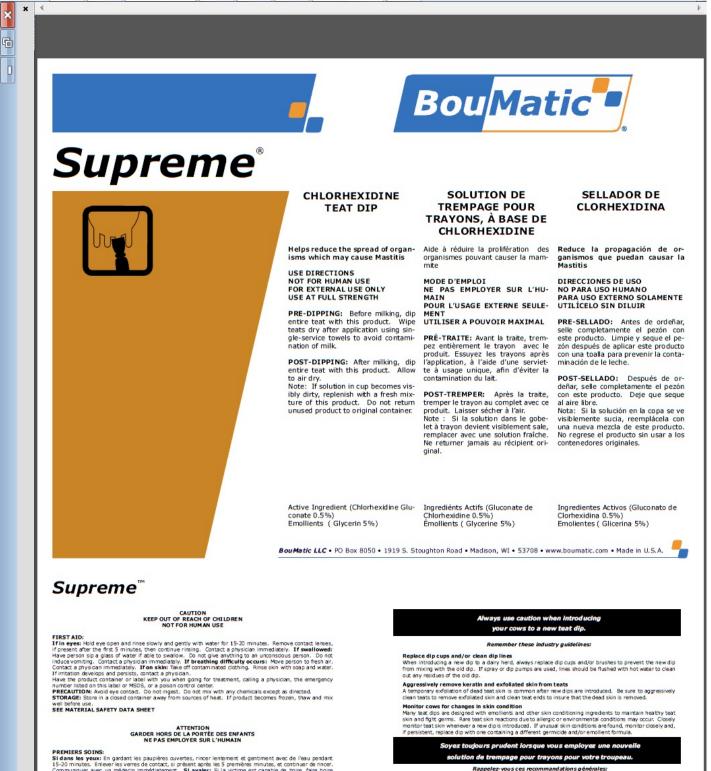

PREMERS SOINS: SI dans les yexus En gardant les paupières ouvertes, rincer lentement et gentiment avec de l'eau pendant 15-20 minutes. Enlever les verres de contact, si présent après les 5 premières minutes, et continuer de nincer. Communquer avec un médicali immédiatement. SI avaiers est capable de boile, faire boilen, lentement un verre d'eau. Ne donner jamais quéque chose à une victime sans connaissance. Ne provoquer pais le vonsiesment. Communiquer avec un médical immédiatement. SI des problèmes respiratoires se font sentrix Ammener la victime à l'air frais. Communiquer avec un médican immédiatement. SI sur la peaus Enlever les véements contamulies. Rincer la région affectée avec de l'eau et du savor. Si une imitation se développe et pensiste, communiquer avec un médicant.

Lorsque vous introduisez une nouvelle solution de trempage pour travons, remplacez les applicateurs et/ou les brosses pour éviter le mélange de la nouvelle solution et de l'ancienne. Si des vaporisateurs ou des pompes sont utilisés, les conduites doivent être lavées à l'eau chaude pour retirer tout résidu de l'ancienne solution.

Remplacez les applicateurs de solution pour trayons et/ou lavez à fond les conduite



#### chlorhexidine gluconate liquid

| Product Informa   | ition   |                          |          |                          |                            |                |                  |  |  |
|---|---|--------------------------|----------|--------------------------|----------------------------|----------------|------------------|--|--|
| Product Type  |   | OTC ANIMAL DRUG Item Cod |          | le (Source)              |                            | NDC:48106-1123 |                  |  |  |
| Route of Administr  | ation   | TOPICAL                  |          |                          |                            |                |                  |  |  |
| Active Ingredient/Active Moiety   |   |                          |          |                          |                            |                |                  |  |  |
| Ingredient Name   |   |                          |          | <b>Basis of Strength</b> |                            | Strength       |                  |  |  |
| CHLORHEXIDINE GLUCONATE (UNII: MOR84MUD8E) (CHLORHEXIDINE - UNII:R4K00DY52L)  |   |                          | DINE -   |                          | CHLORHEXIDINE<br>GLUCONATE |                | 54 mL<br>in 10 L |  |  |
| Packaging#Item CodePackage DescriptionMarketing Start DateMarketing End Da  |   |                          |          |                          |                            |                |                  |  |  |
|   |   | Package Description      |          | Marke                    | ting Start Date            | Marketii       | ng End Dat       |  |  |
| # Item Code   |   | Package Description      |          | Marke                    | eting Start Date           | Marketin       | ng End Dat       |  |  |
| Item Code           NDC:48106-1123-1  | 3.8 L in 1 DRUM   |                          |          | Marko                    | ting Start Date            | Marketin       | ng End Dat       |  |  |
| Item Code           NDC:48106-1123-1           NDC:48106-1123-2   | 3.8 L in 1 DRUM<br>18.9 L in 1 DRUM   | 1                        |          | Marke                    | eting Start Date           | Marketin       | ng End Dat       |  |  |
| Item Code           NDC:48106-1123-1           NDC:48106-1123-2           NDC:48106-1123-3  | 3.8 L in 1 DRUM<br>18.9 L in 1 DRUM<br>56.8 L in 1 DRUM   | 1                        |          | Marke                    | ting Start Date            | Marketin       | ng End Dat       |  |  |
| <ul> <li>Item Code</li> <li>NDC:48106-1123-1</li> <li>NDC:48106-1123-2</li> <li>NDC:48106-1123-3</li> <li>NDC:48106-1123-4</li> </ul>   | 3.8 L in 1 DRUM<br>18.9 L in 1 DRUM<br>56.8 L in 1 DRUM<br>114 L in 1 DRUM  | 1                        |          | Marko                    | eting Start Date           | Marketin       | ng End Dat       |  |  |
| <ul> <li>Hitem Code</li> <li>NDC:48106-1123-1</li> <li>NDC:48106-1123-2</li> <li>NDC:48106-1123-3</li> <li>NDC:48106-1123-4</li> <li>NDC:48106-1123-5</li> <li>NDC:48106-1123-5</li> </ul>  | <ul> <li>3.8 L in 1 DRUM</li> <li>18.9 L in 1 DRUM</li> <li>56.8 L in 1 DRUM</li> <li>114 L in 1 DRUM</li> <li>208 L in 1 DRUM</li> </ul> | 1                        |          | Marko                    | ting Start Date            | Marketin       | ng End Dat       |  |  |
| <ul> <li>Hitem Code</li> <li>NDC:48106-1123-1</li> <li>NDC:48106-1123-2</li> <li>NDC:48106-1123-3</li> <li>NDC:48106-1123-4</li> <li>NDC:48106-1123-5</li> <li>NDC:48106-1123-5</li> </ul>  | <ul> <li>3.8 L in 1 DRUM</li> <li>18.9 L in 1 DRUM</li> <li>56.8 L in 1 DRUM</li> <li>114 L in 1 DRUM</li> <li>208 L in 1 DRUM</li> </ul> | 1                        |          | Marke                    | eting Start Date           | Marketin       | ng End Dat       |  |  |
| <ul> <li>Item Code</li> <li>NDC:48106-1123-1</li> <li>NDC:48106-1123-2</li> <li>NDC:48106-1123-3</li> <li>NDC:48106-1123-4</li> <li>NDC:48106-1123-5</li> <li>NDC:48106-1123-5</li> </ul>   | 3.8 L in 1 DRUM<br>18.9 L in 1 DRUM<br>56.8 L in 1 DRUM<br>114 L in 1 DRUM<br>208 L in 1 DRUM<br>1040 L in 1 CON                          | 1                        |          | Marke                    | eting Start Date           | e Marketin     | ng End Dat       |  |  |
| <ul> <li>H Item Code</li> <li>NDC:48106-1123-1</li> <li>NDC:48106-1123-2</li> <li>NDC:48106-1123-3</li> <li>NDC:48106-1123-4</li> <li>NDC:48106-1123-5</li> <li>NDC:48106-1123-5</li> </ul> | 3.8 L in 1 DRUM<br>18.9 L in 1 DRUM<br>56.8 L in 1 DRUM<br>114 L in 1 DRUM<br>208 L in 1 DRUM<br>1040 L in 1 CON                          | 1                        | ATE BULK |                          | eting Start Date           |                | ng End Dat       |  |  |

# Registrant - BouMatic, LLC (124727400)

# Establishment

| Name          | Address | ID/FEI    | <b>Business Operations</b>   |  |  |  |  |
|---------------|---------|-----------|------------------------------|--|--|--|--|
| BouMatic, LLC |         | 124727400 | manufacture, api manufacture |  |  |  |  |

Revised: 1/2012

BouMatic, LLC